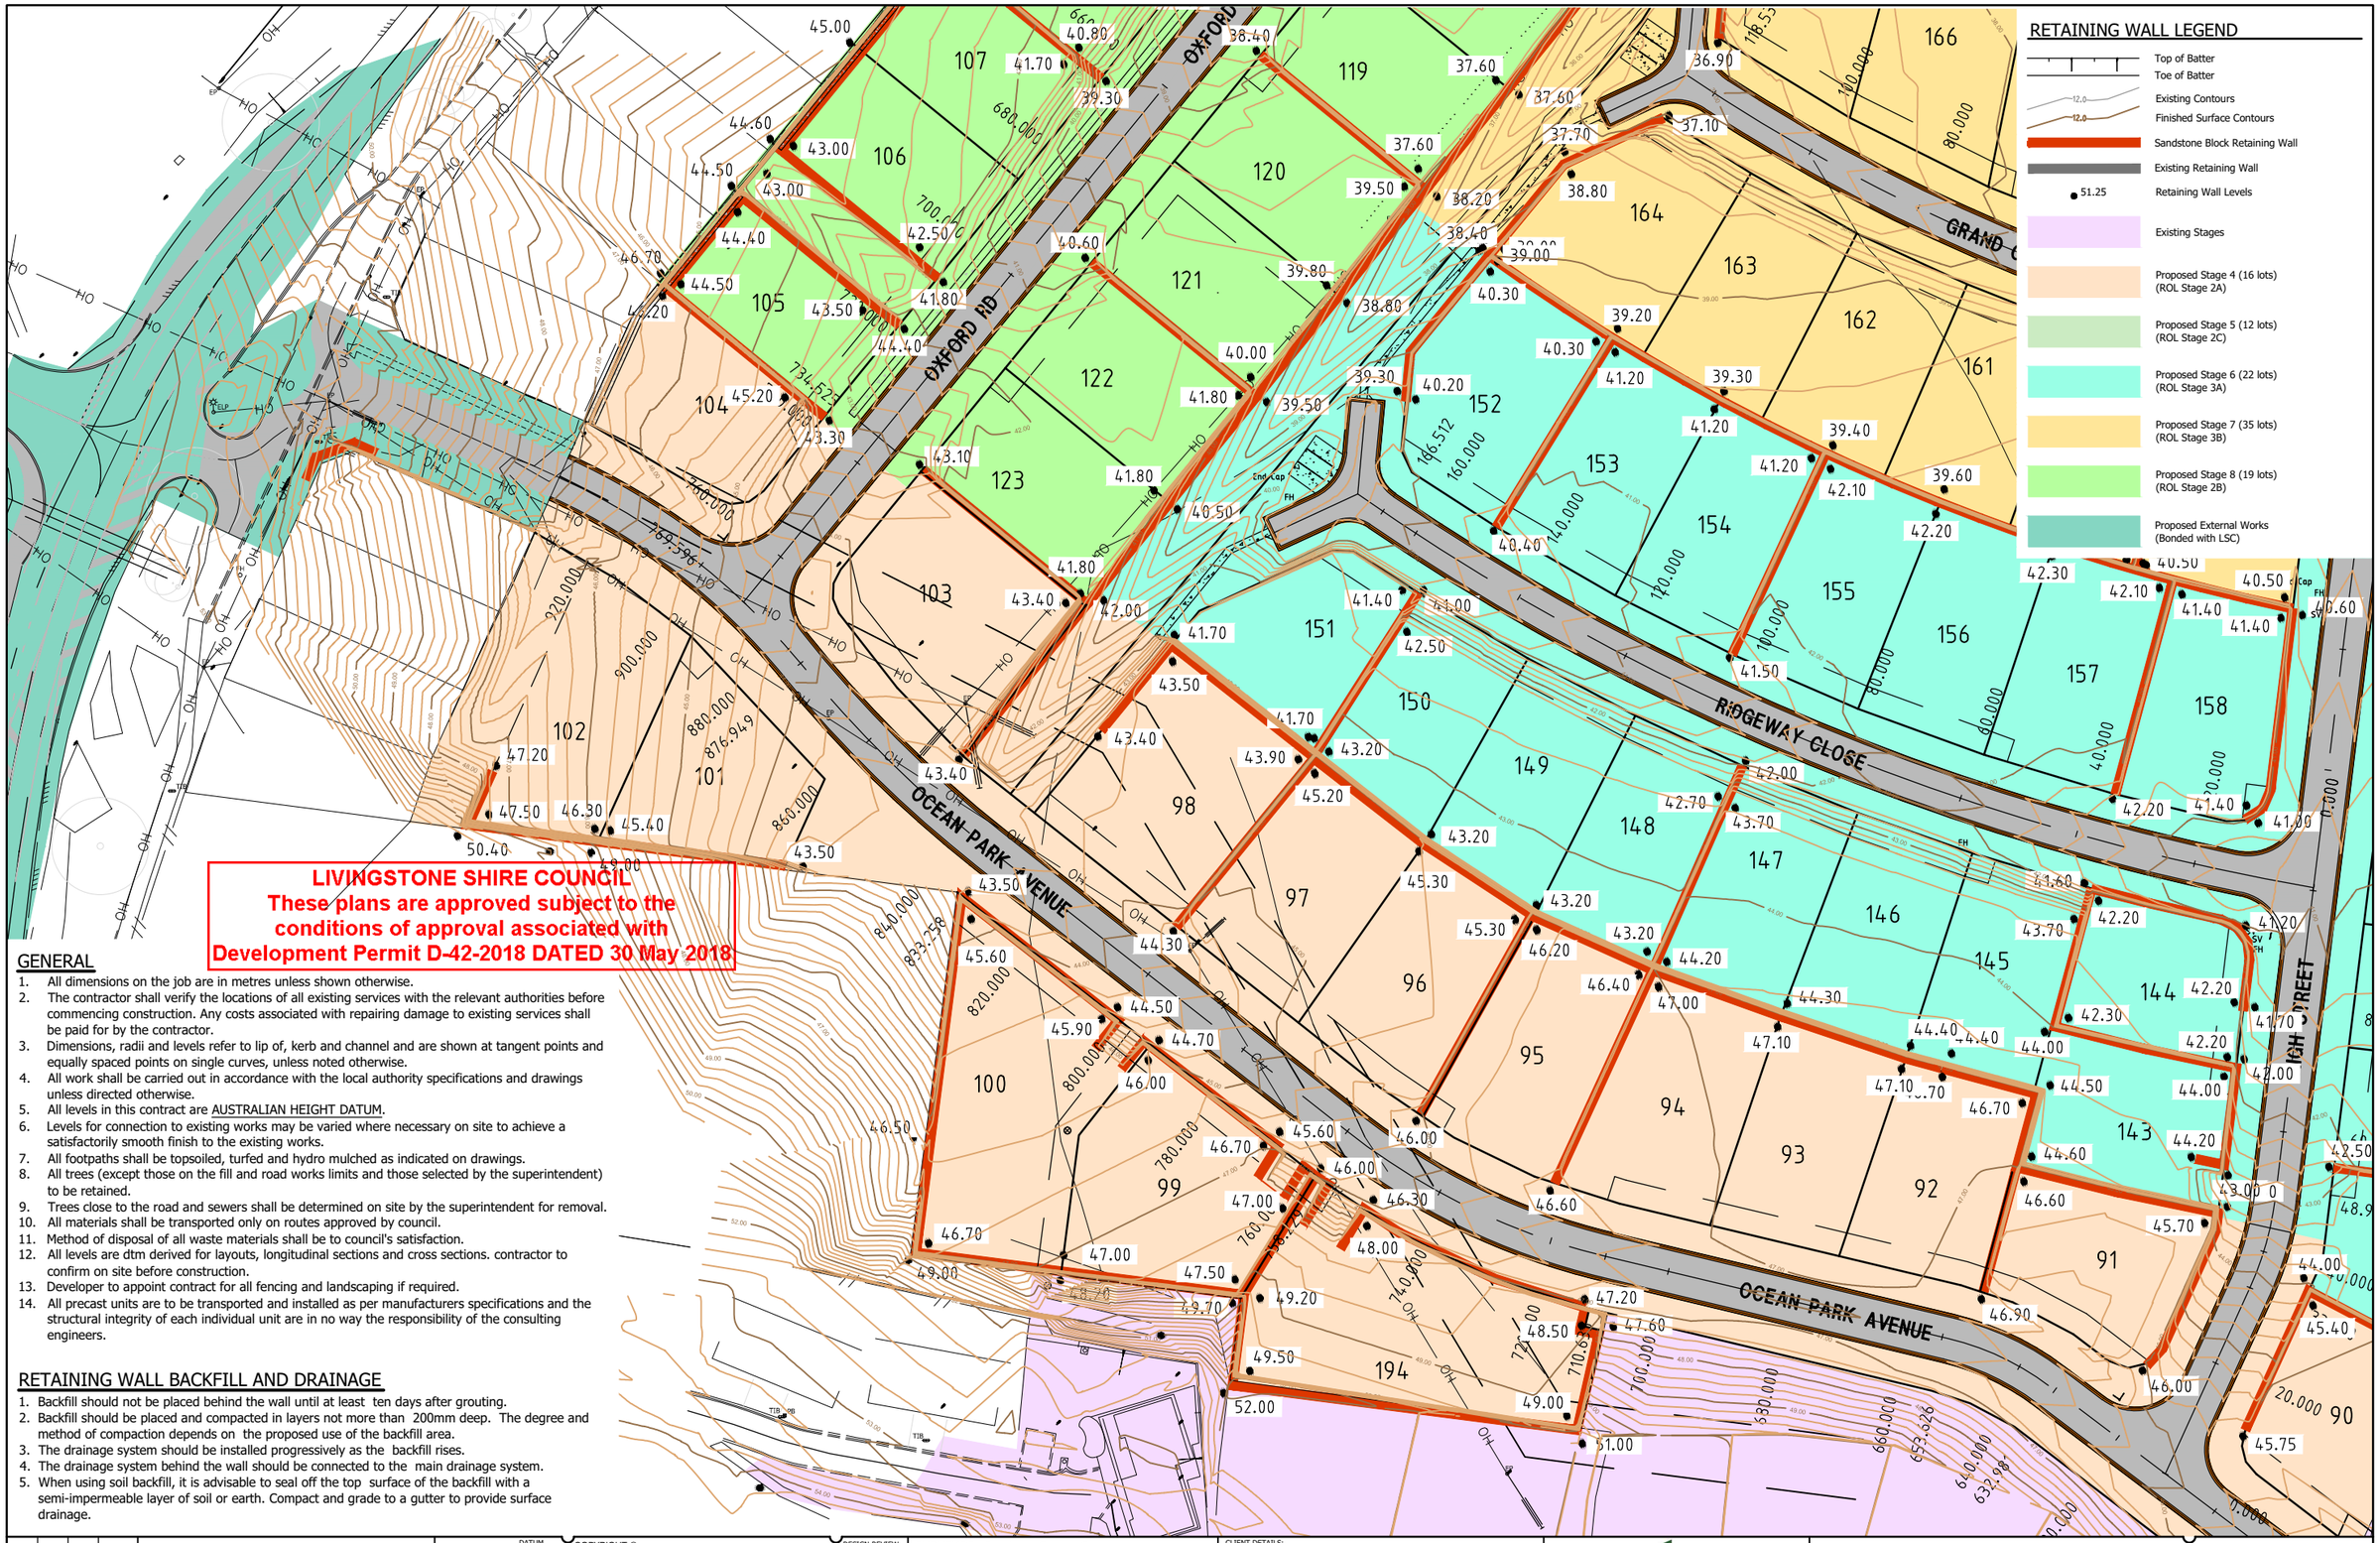


GENERAL

1. All dimensions on the job are in metres unless shown otherwise.
2. The contractor shall verify the locations of all existing services with the relevant authorities before commencing construction. Any costs associated with repairing damage to existing services shall be paid for by the contractor.
3. Dimensions, radii and levels refer to lip of, kerb and channel and are shown at tangent points and equally spaced points on single curves, unless noted otherwise.
4. All work shall be carried out in accordance with the local authority specifications and drawings unless directed otherwise.
5. All levels in this contract are AUSTRALIAN HEIGHT DATUM.
6. Levels for connection to existing works may be varied where necessary on site to achieve a satisfactorily smooth finish to the existing works.
7. All footpaths shall be topsoiled, turfed and hydro mulched as indicated on drawings.
8. All trees (except those on the fill and road works limits and those selected by the superintendent) to be retained.
9. Trees close to the road and sewers shall be determined on site by the superintendent for removal.
10. All materials shall be transported only on routes approved by council.
11. Method of disposal of all waste materials shall be to council's satisfaction.
12. All levels are dtm derived for layouts, longitudinal sections and cross sections. contractor to confirm on site before construction.
13. Developer to appoint contract for all fencing and landscaping if required.
14. All precast units are to be transported and installed as per manufacturers specifications and the structural integrity of each individual unit are in no way the responsibility of the consulting engineers.

RETAINING WALL BACKFILL AND DRAINAGE

1. Backfill should not be placed behind the wall until at least ten days after grouting.
2. Backfill should be placed and compacted in layers not more than 200mm deep. The degree and method of compaction depends on the proposed use of the backfill area.
3. The drainage system should be installed progressively as the backfill rises.
4. The drainage system behind the wall should be connected to the main drainage system.
5. When using soil backfill, it is advisable to seal off the top surface of the backfill with a semi-impermeable layer of soil or earth. Compact and grade to a gutter to provide surface drainage.

ISSUE	DESIGN	DRAWN	DATE	REVISION DETAILS
A	DWC	RLS	02/2018	CIVIL WORKS OPW SUBMISSION
B	DWC	RLS	04/18	INFO REQUEST RESPONSE

REVISION

DATUM AHD
CO-ORD. GDA94

COPYRIGHT ©
THESE DESIGNS AND DRAWINGS ARE COPYRIGHT AND BELONG THE PROPERTY OF SIRIS AND ASSOCIATES CONSULTING ENGINEERS. THESE DRAWINGS AND DESIGNS ARE NOT TO BE REPRODUCED OR USED WITHOUT THE WRITTEN CONSENT OF THE ABOVE MENTIONED COMPANY. THE CONTENTS OF THESE DRAWINGS ARE ELECTRONICALLY GENERATED, CONFIDENTIAL AND ARE ONLY TO BE USED FOR THE PURPOSE INTENTED BY THE ABOVE MENTIONED COMPANY. DO NOT SCALE FROM THIS PLAN. ALL DIMENSIONS ARE TO BE VARIFIED ON SITE PRIOR TO CONSTRUCTION.

DESIGN REVIEW
SURVEYOR: Capricorn Survey Group
CIVIL DESIGNER: Contour Consulting
LANDSCAPE DESIGNER: Contour Consulting
DRAFTING REVIEW
RPEQ CERTIFICATION: Harsha Weerasinghe RPEQ 8372
FOR & ON BEHALF OF SIRIS & ASSOCIATES CONSULTING ENGINEERS

CLIENT DETAILS:
MILES DEVELOPMENTS PTY LTD
DEVELOPMENT DETAILS:
CENTRAL PARK ESTATE (Stages 4 - 8)
OCEAN PARK AVENUE
YEPPOON, CAPRICORN COAST

SIRIS CONSULTING ENGINEERS
ADDRESS: PO Box 2295, Yeppoon, QLD, 4703 ABN:34 481 028 699
PHONE: 07 4930 2877 (office), 0404 119 734 (mobile)
EMAIL: david@sirisengineers.com.au

104 LOT RESIDENTIAL SUBDIVISION RETAINING WALL PLAN 4

PLAN NUMBER SCE-121-111
REVISION B

0 5.0 20.0m
1:1000
DO NOT SCALE - ASK IF IN DOUBT